
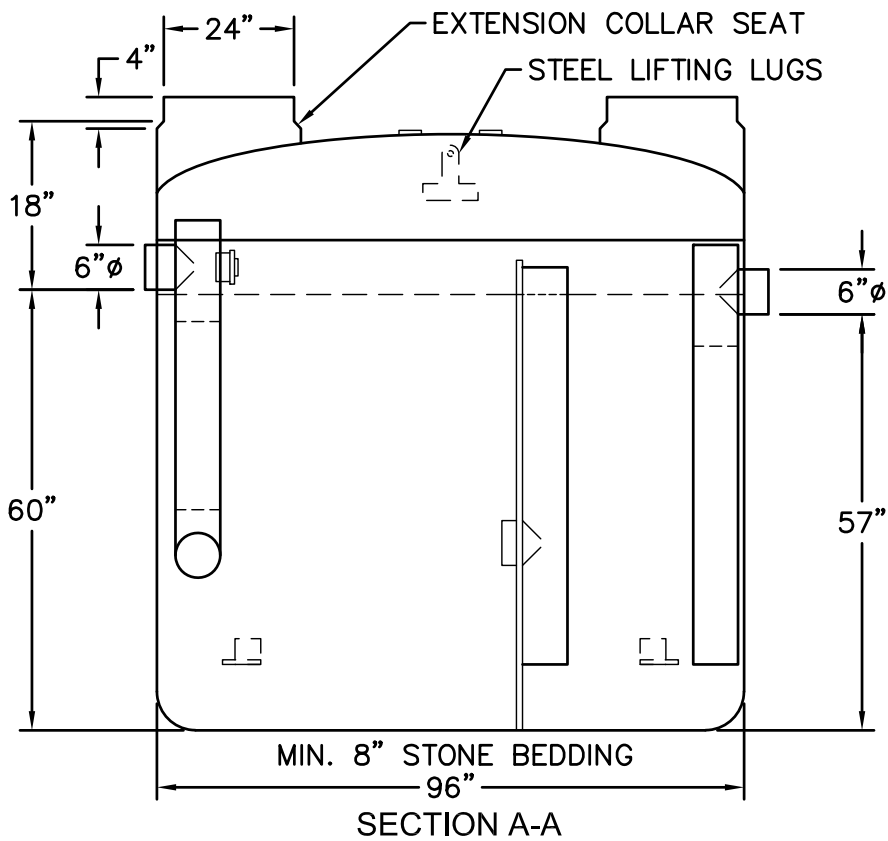
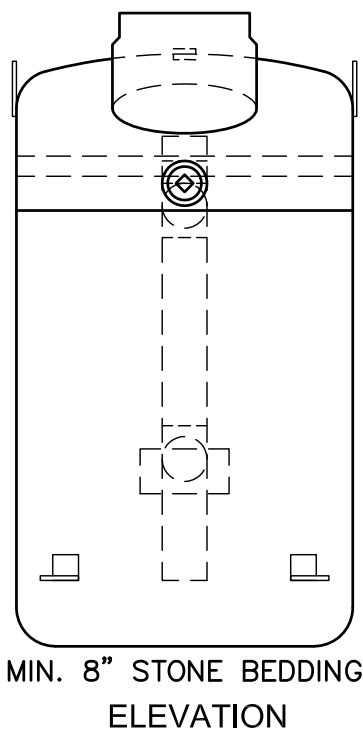


S:\TreatmentEng\CMV\Engineers\2003_Project Management\2017 Projects\Standards Update 314817.045\CFPUA Dwg Details\CAD\EM-3 Fiberglass Grease Interceptor.dwg, 12/3/2024 8:19:52 AM, justin.hanes

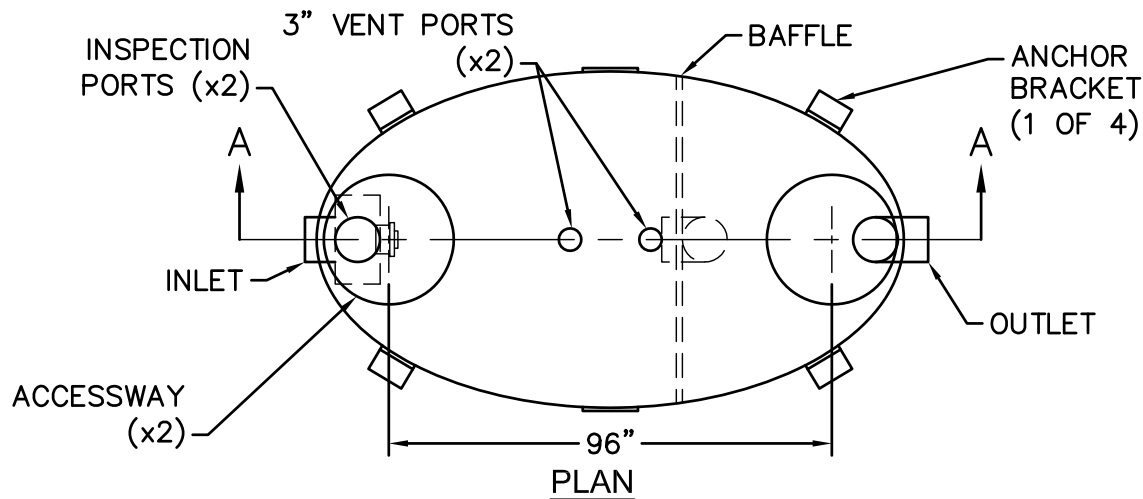

NOTES:

1. FOR GRAVITY APPLICATIONS ONLY.
2. MIN. THICKNESS: 1/4" WALL AND 3/8" TOP AND BOTTOM BOWLS.
3. STANDARD PIPE STUBS ARE SOCKET SDR 35 PVC.
4. EXTENSION COLLARS SHALL BE CAULKED WITH SIKAFLEX OR EQUIVALENT FOR WATERTIGHT SEAL.
5. FOLLOW MANUFACTURE'S SPECS FOR TRAFFIC OR PEDESTRIAN LOADING.
6. MUST COMPLETE CFPUA'S APPLICATION FOR AUTHORIZATION TO CONSTRUCT. CONTACT COMMUNITY COMPLIANCE AT 910-332-6558 OR VISIT WWW.CFPUA.ORG/COMMUNITYCOMPLIANCE AND COMPLETE THE ONLINE FORM.
7. SHALL BE SIZED TO ACHIEVE A MINIMUM 20 MINUTE DETENTION TIME.
8. ALL FIXTURES AND DRAINS RECEIVING GREASE LADEN SOURCES FROM KITCHEN OR FOOD PREPARATION WASTE WATER SHALL PASS THROUGH THE GREASE INTERCEPTOR.

DETAIL:

FIBERGLASS GREASE INTERCEPTOR

SCALE: NOT TO SCALE

CFPUA DETAIL DATE:

01/01/2025



CAPE FEAR PUBLIC UTILITY AUTHORITY
235 GOVERNMENT CENTER DRIVE
WILMINGTON, NC 28403
OFFICE: (910)332-6560

DETAIL NO:

EM-3

SHEET NO:

-