NOTES:

1. COORDINATE GENERATOR PAD SIZE WITH GENERATOR MANUFACTURER.
2. MAINTENANCE PLATFORM SHALL BE INSTALLED WHEN THE MIDLINE HEIGHT OF THE GENERATOR BREAKER EXCEEDS 6.5 FT ABOVE THE GROUND OR FLOOR, IN ACCORDANCE WITH NEC 110.26.
3. SUBMIT TO ENGINEER, ALL INFORMATION ON PROPOSED MAINTENANCE PLATFORM FOR APPROVAL PRIOR TO ORDERING GENSET AND PLATFORM.
4. SEE SPECIFICATIONS FOR ADDITIONAL GENERAL REQUIREMENTS/INFORMATION.
5. STRUCTURAL DESIGN SHOWN IS GENERAL, ACTUAL STRUCTURAL DESIGN SHALL BE SITE SPECIFIC.

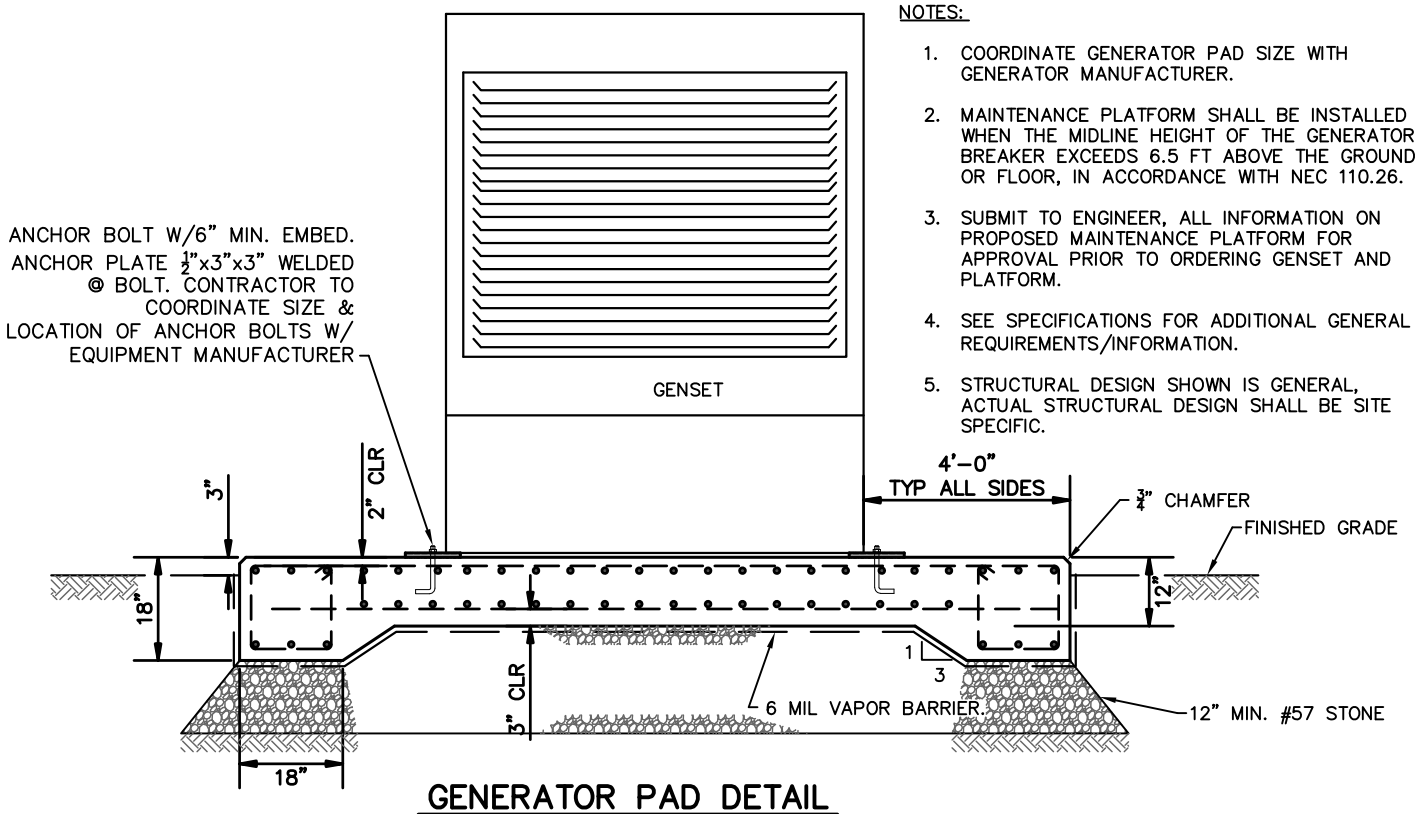

GENERATOR PAD DETAIL

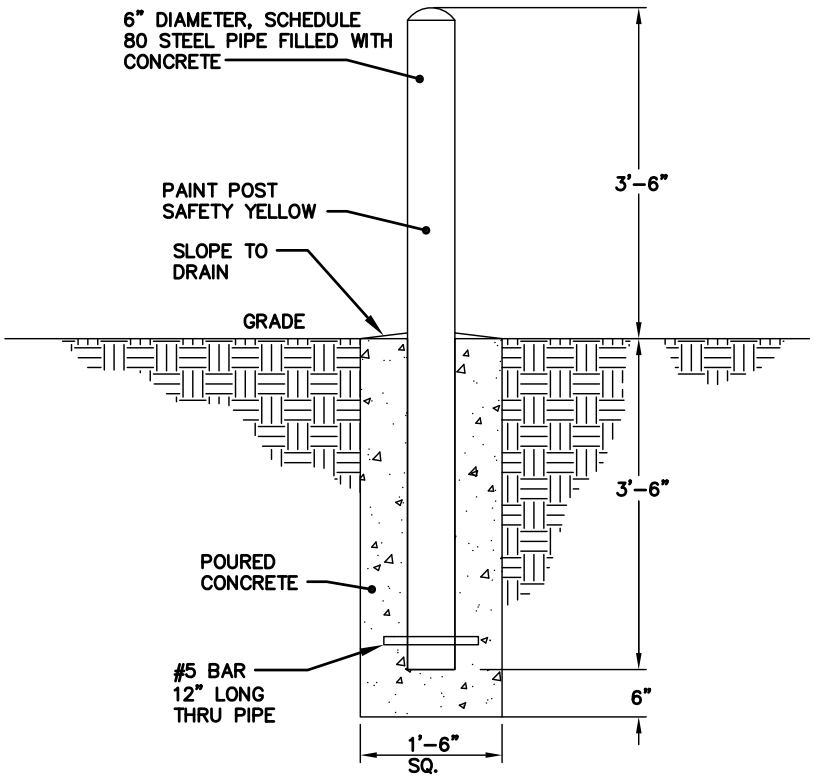

BOLLARD DETAIL

DETAIL: **GENERATOR PAD AND BOLLARD DETAILS**		CAPE FEAR PUBLIC UTILITY AUTHORITY 235 GOVERNMENT CENTER DRIVE WILMINGTON, NC 28403 OFFICE: (910)332-6560	DETAIL NO: **PS-C6**
SCALE: NOT TO SCALE	CFPUA DETAIL DATE: 01/01/2025		SHEET NO: -

S:\TreatmentEngCM\Engineers\2003_Project Management\2017 Projects\-Standards Update 314817.045\CFPUA Dwg Details\CAD\PS-C6 Generator Pad and Bollard Details.dwg, 12/19/2024 7:55:54 AM, justin.hanes