


- ORIENT BUILDING SO THAT THE WET WELL CAN BE VIEWED THROUGH THE DOOR WHEN STANDING AT THE PUMP CONTROL PANEL.
- TERMINAL CABINET AND CABLE TRAY SHALL BE LOCATED ON THE SIDE OR FRONT OF THE BUILDING. IF IT IS DETERMINED THAT THE STANDARD 50' PUMP CABLE WILL NOT REACH PUMPS, DISCUSS WITH CFPUA ON ALTERNATE LOCATION OF CABLE TRAY.



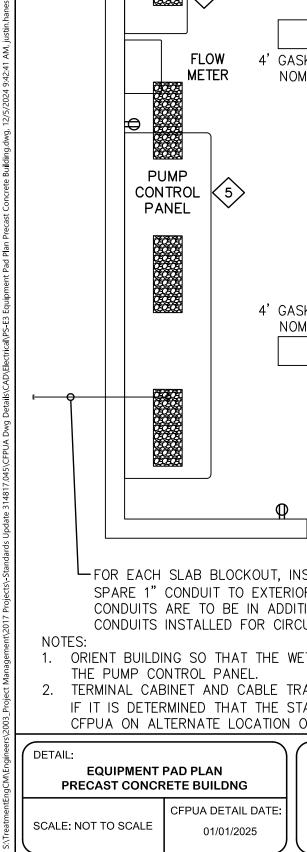

CAPE FEAR PUBLIC UTILITY AUTHORITY 235 GOVERNMENT CENTER DRIVE WILMINGTON, NC 28403 OFFICE: (910)332-6560

DETAIL NO: PS-E3 SHEET NO: