


S:\TreatmentEng\CMV\Engineers\2003_Project Management\2017 Projects\Standards Update 314817.045\CFPUA Dwg Details\CADW-11 Double Service Connection Using Subtract Meter.dwg 12/2/2024 1:35:34 PM, Justin.Hanes

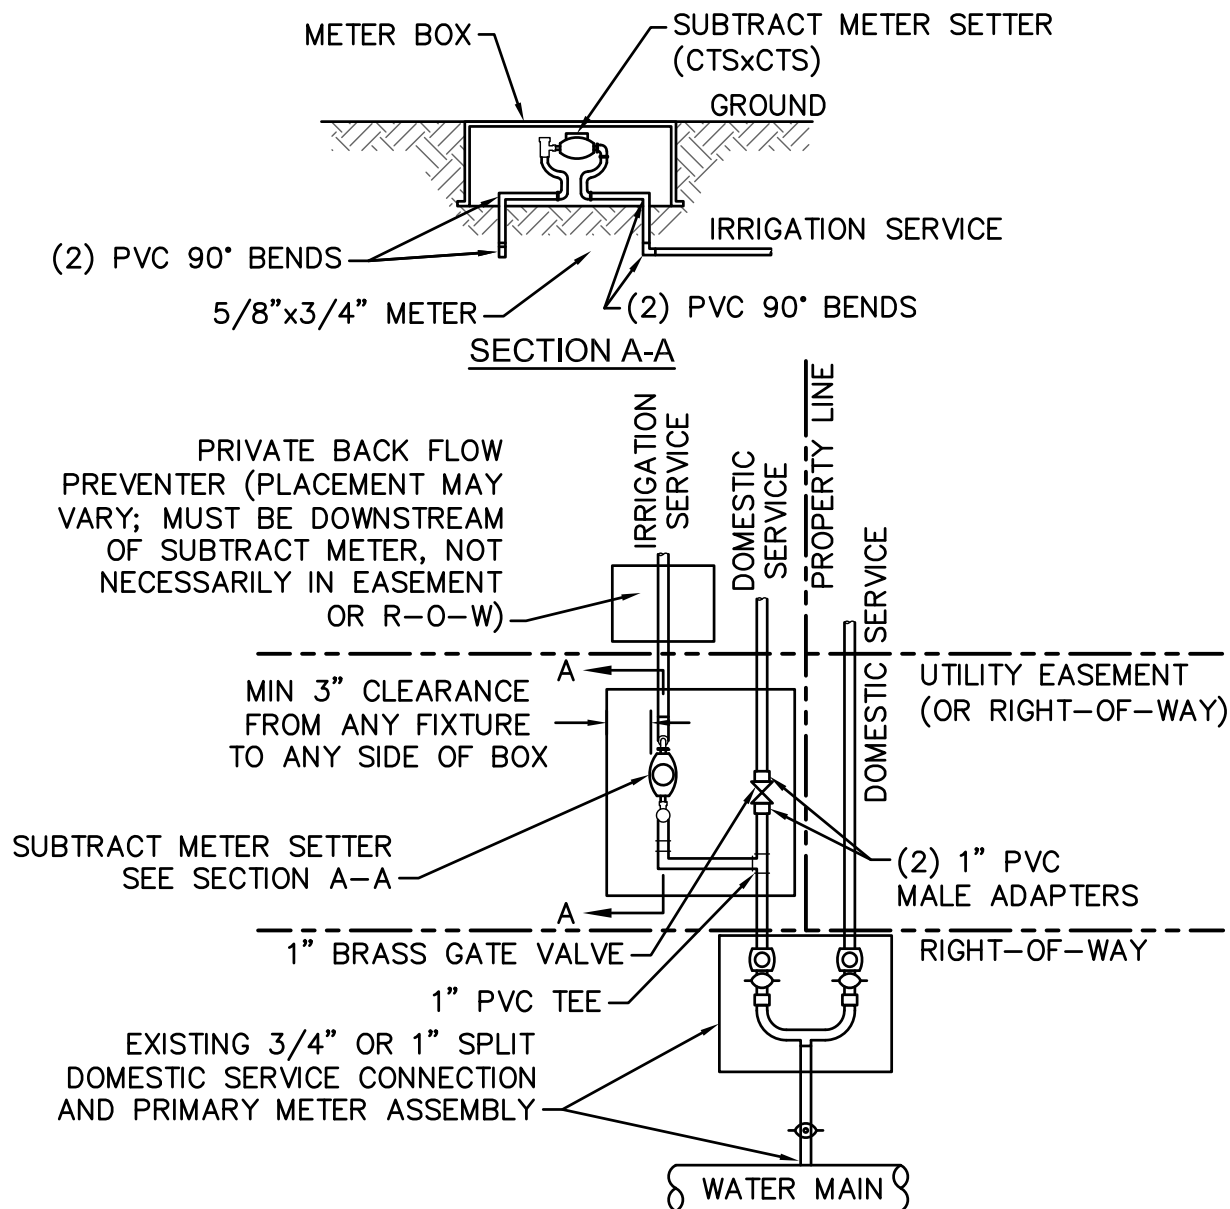

NOTES:

1. BEYOND THE PRIMARY DOMESTIC METER ASSEMBLY, CFPUA IS ONLY RESPONSIBLE FOR METER AND WASHERS OF SUBTRACT METER ASSEMBLY.
2. ALL PIPE AND FITTINGS UP TO FINAL SERVICE LINE TO BE 1" EXCLUDING METERS.

PLAN VIEW

(MULTIPLE DOMESTIC SERVICES PER TAP)

DETAIL:

**DOUBLE SERVICE CONNECTION USING
SUBTRACT METER**

SCALE: NOT TO SCALE

CFPUA DETAIL DATE:

01/01/2025



CAPE FEAR PUBLIC UTILITY AUTHORITY
235 GOVERNMENT CENTER DRIVE
WILMINGTON, NC 28403
OFFICE: (910)332-6560

DETAIL NO:

W-11

SHEET NO:

-