


S:\TreatmentEng\CM\Engineers\2003_Project Management\2017 Projects\Standards Update 314817.045\CFPUA Dwg Details\CAD\LP-5 Grinder Pump Station Remote Vent.dwg, 12/3/2024 9:03:04 AM, justin.hanes

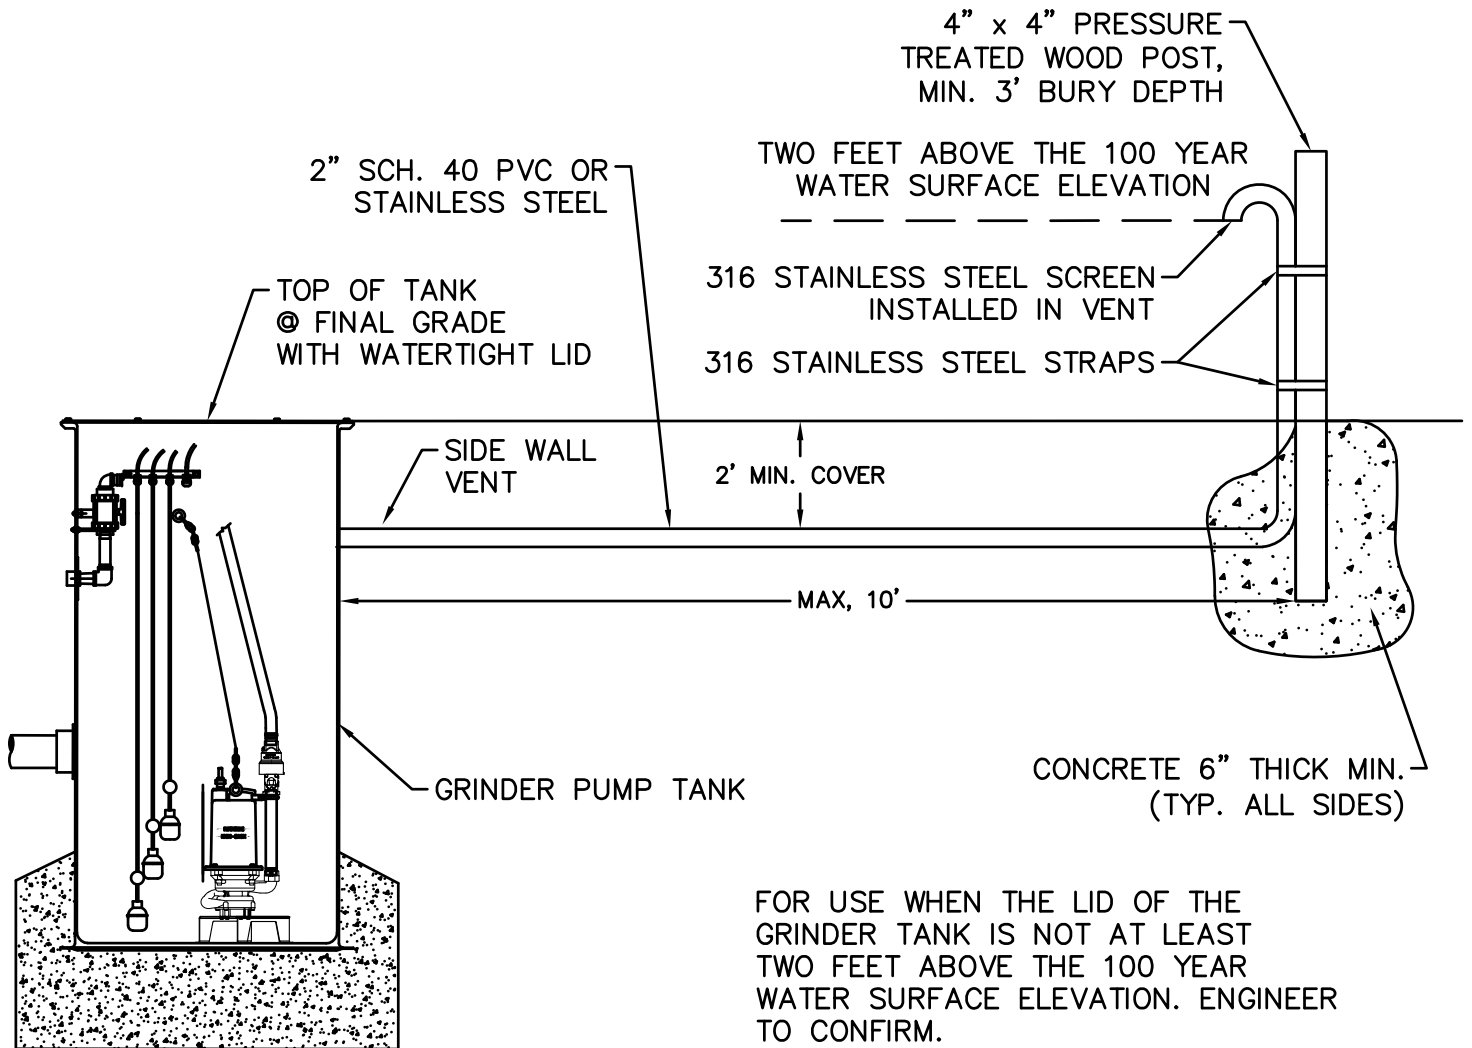

1. SCH. 40 PVC VENT PIPING MAY BE APPROVED BY CFPUA. PRIOR APPROVAL REQUIRED.

DETAIL:

**GRINDER PUMP STATION
REMOTE VENT**

SCALE: NOT TO SCALE

CFPUA DETAIL DATE:

01/01/2025



CAPE FEAR PUBLIC UTILITY AUTHORITY
235 GOVERNMENT CENTER DRIVE
WILMINGTON, NC 28403
OFFICE: (910)332-6560

DETAIL NO:

LP-5

SHEET NO:

-