


## NOTES:

- REFER TO CFPUA SPECIFICATIONS AND CFPUA MSM FOR PIPING MATERIAL AND SIZE REQUIREMENTS.
- ALL FITTINGS TO BE RESTRAINED JOINT. 2.
- CAMLOCK CLEAN-OUT FITTING IS TO BE 2" IN DIAMETER. A CONCENTRIC REDUCER/INCREASER SHALL BE INSTALLED ON VERTICAL STANDPIPE IF LOW PRESSURE SEWER PIPING IS NOT 2" IN DIAMETER.



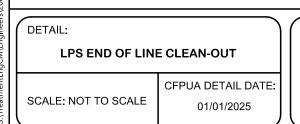

CAPE FEAR PUBLIC UTILITY AUTHORITY 235 GOVERNMENT CENTER DRIVE WILMINGTON, NC 28403 OFFICE: (910)332-6560

DETAIL NO: LP-6

SHEET NO: