


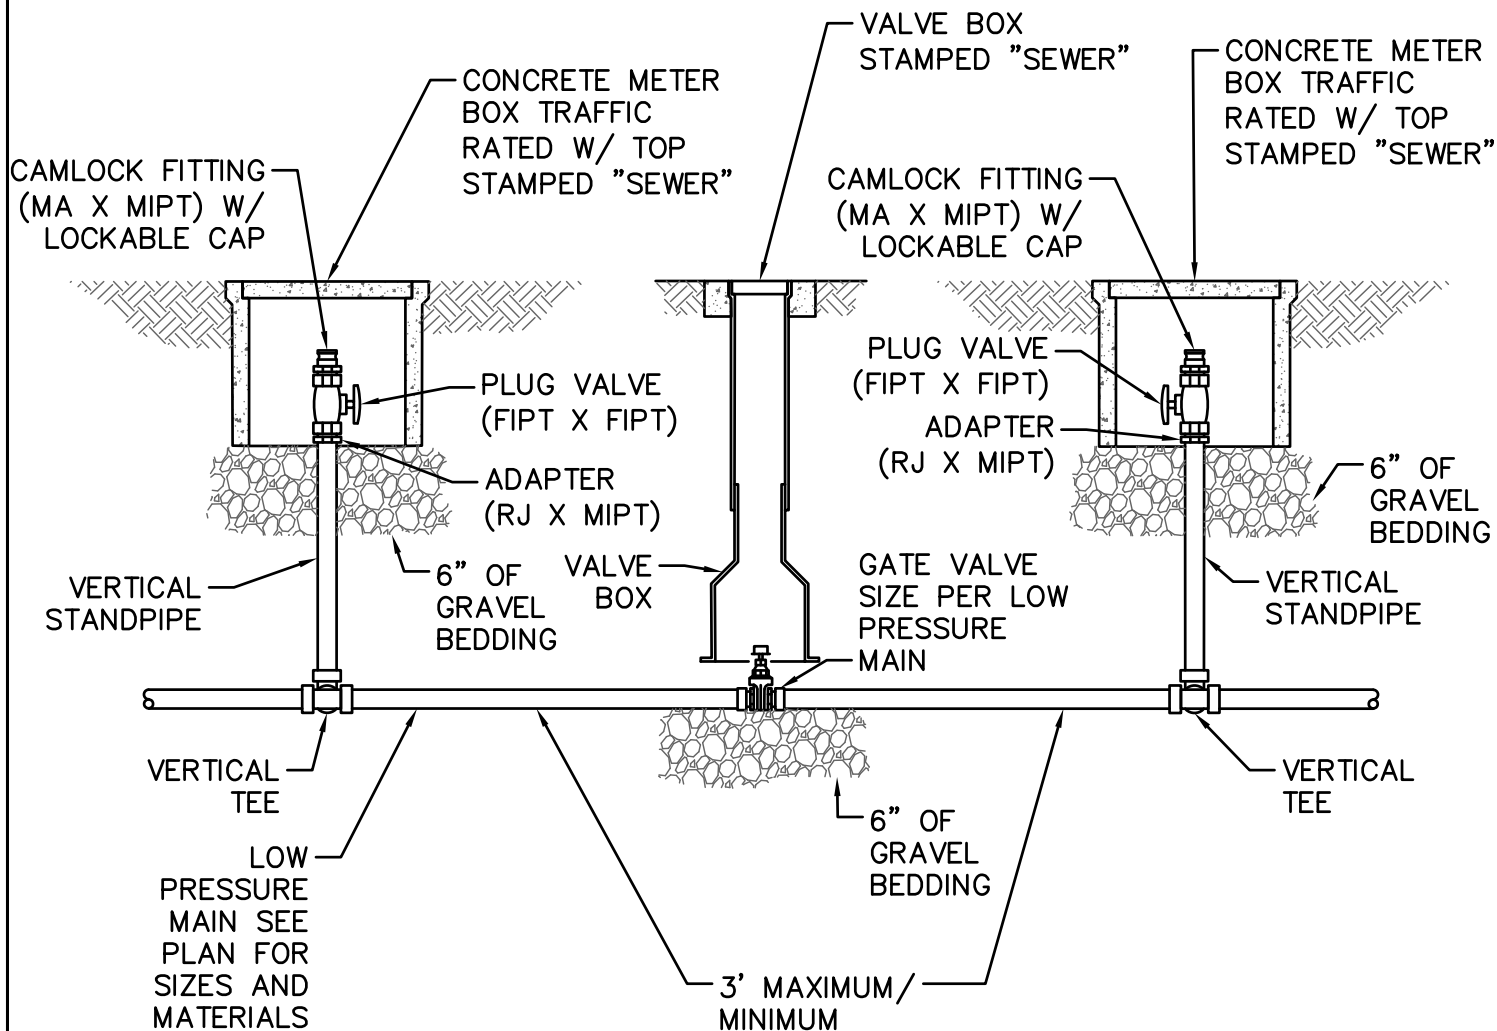

# **NOTES:**

1. REFER TO CFPUA SPECIFICATIONS AND CFPUA MSM FOR PIPING MATERIAL AND SIZE REQUIREMENTS.
2. ALL FITTINGS TO BE RESTRAINED JOINT.
3. CAMLOCK CLEAN-OUT FITTING IS TO BE 2" IN DIAMETER. A CONCENTRIC REDUCER/INCREASER SHALL BE INSTALLED ON VERTICAL STANDPIPE IF LOW PRESSURE SEWER PIPING IS NOT 2" IN DIAMETER.

DETAIL:

**LPS IN-LINE CLEAN-OUT**

SCALE: NOT TO SCALE

CFPUA DETAIL DATE:

01/01/2025



**CAPE FEAR PUBLIC UTILITY AUTHORITY**  
235 GOVERNMENT CENTER DRIVE  
WILMINGTON, NC 28403  
OFFICE: (910)332-6560

DETAIL NO:

**LP-7**

SHEET NO:

-